


SIDE SEWER PLAN

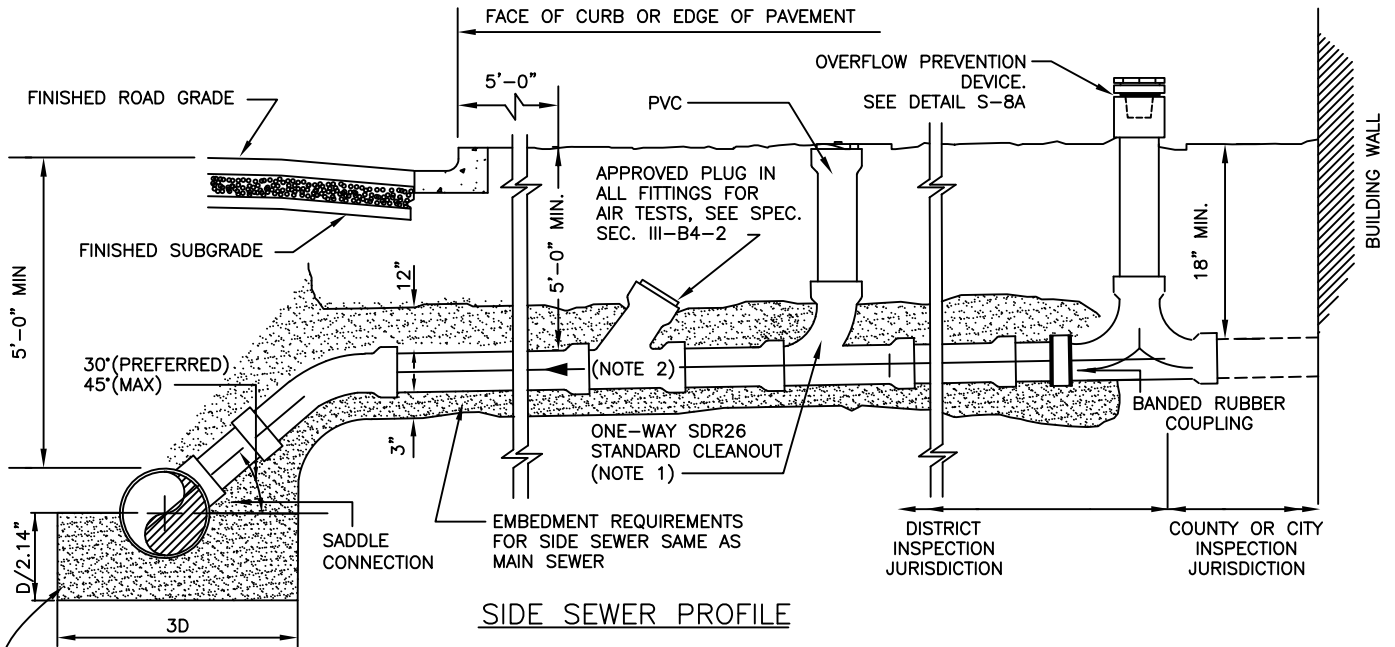

SIDE SEWER PROFILE

CLASS A OR B CONCRETE REQUIRED WHEN SERVICE ANGLE GREATER THAN 30°

NOTE:

1. CLEANOUT SHALL BE EQUAL IN SIZE TO SIDE SEWER. SEE SECTION III-A6 FOR LOCATION.
2. MIN. SLOPE SHALL BE 0.02 FT/FT (S=0.02).
3. SIDE SEWER, INCLUDING LATERAL SEWER AND HOUSE SEWER, IS OWNED AND MAINTAINED BY THE OWNER OF THE PROPERTY IT SERVES.
4. INSTALL SEWER OVERFLOW PREVENTION DEVICE ON ALL LATERALS. SEE DRAWING S-8A.
5. FOR SIDE SEWER REPLACEMENTS, AIR TEST REQUIRED AT 3 PSI FOR 3 MINUTES.
6. FOR SIDE SEWER REPAIRS, STAINLESS STEEL ADJUSTABLE REPAIR COUPLINGS ARE REQUIRED.

Dublin San Ramon Services District

DATE
FEB 2021

TYPICAL SIDE SEWER INSTALLATION

DESIGNED
RM

SIGNED COPY ON FILE AT DISTRICT OFFICE

DRAWING
S-8