



PLAN

NTS

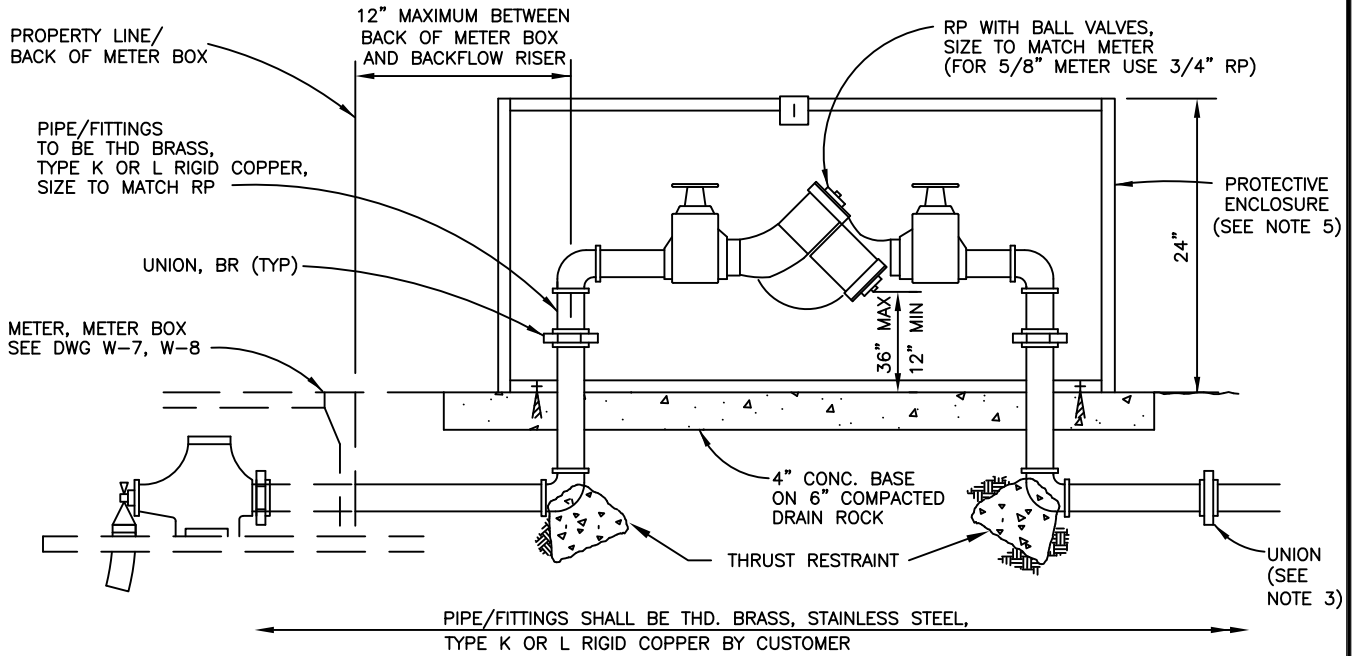

SECTION

NTS



NOTES:

1. SET RP ON PRIVATE PROPERTY.
2. IF RP IS LOCATED NEAR TRAFFIC AREA, A MIN. OF TWO 4" GALVANIZED STEEL GUARD POSTS SHALL BE PROVIDED. POSTS SHALL BE 42" HIGH, EMBEDDED 36" BELOW GROUND IN CONCRETE, AND FILLED WITH CONCRETE.
3. FITTING SHALL BE DIELECTRIC WHERE JOINING DISSIMILAR METALS.
4. 3/4" TO 2" MUST HAVE BALL VALVE SHUT OFF VALVES.
5. PROVIDE LOCKABLE ENCLOSURE WITH FOAM INSULATION LINING, OR BLANKET (SEE DRAWING W-25).
6. DIMENSION OF CONCRETE PAD TO BE AS RECOMMENDED BY ENCLOSURE MANUFACTURER.
7. DEVICE SHALL BE TESTED BY CERTIFIED TESTER. TEST REPORT SHALL BE SUBMITTED TO DSRSD.
8. THE CONCRETE PAD SHALL ACCOMODATE ENCLOSURES. SEE W-25 FOR ENCLOSURE DETAILS.

Dublin San Ramon Services District

REVISION DATE

JUN 2020

BACKFLOW PREVENTER
INSTALLATION 3/4" TO 2"

REVISED BY

BD

SIGNED COPY ON FILE AT DISTRICT OFFICE

DRAWING

W-21