


FOR PIPE SIZE \leq 2-INCH

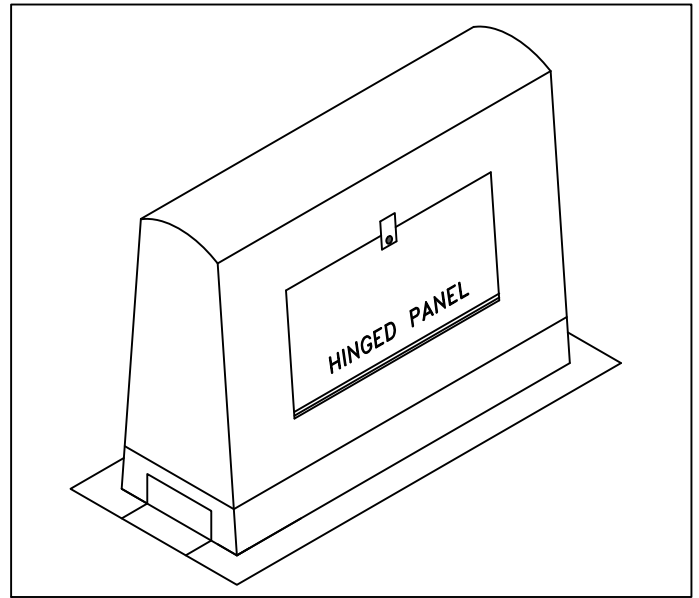

FOR PIPE SIZES $>$ 2-INCH

PIPE SIZE	INSIDE DIMENSIONS		
	W	L	H
3/4"-1"	8	25	19
3/4"-1"	9	26	19
1 1/4"-2"	11	35	24
1 1/4"-2"	12	37	30
1 1/4"-2"	12	46	30
1 1/4"-2"	12	46	31
2 1/2"-3"	24	67	45
4"	29	65	50
6"	28	104	49
8"-10"	40	157	74

NOTES:

1. ENCLOSURE SHALL BE AS SPECIFIED ON APPROVED MATERIALS LIST, OR EQUAL.
2. CONCRETE PAD SHALL EXTEND 4 INCHES BEYOND THE EDGE OF THE ENCLOSURE.

REV. 11/19

Dublin San Ramon Services District	DATE DEC 2019
FIBERGLASS ENCLOSURE FOR BACKFLOW PREVENTER	DESIGNED RM
SIGNED COPY ON FILE AT DISTRICT OFFICE	DRAWING W-25