


NOTES:

1. RP SHALL BE SIZED BY CONTRACTOR TO MEET AWWA STANDARD FOR FLUSHING.
2. CONSTRUCTION JUMPER TO BE REMOVED ONCE TESTING IS COMPLETED.
3. AFTER TESTING IS COMPLETED, ALL PIECES OF CONSTRUCTION JUMPER (INCLUDING THE TEES) SHALL BE REMOVED AND A STRAIGHT PIPE TO COMPLETE THE WATER MAIN SHALL BE INSTALLED.

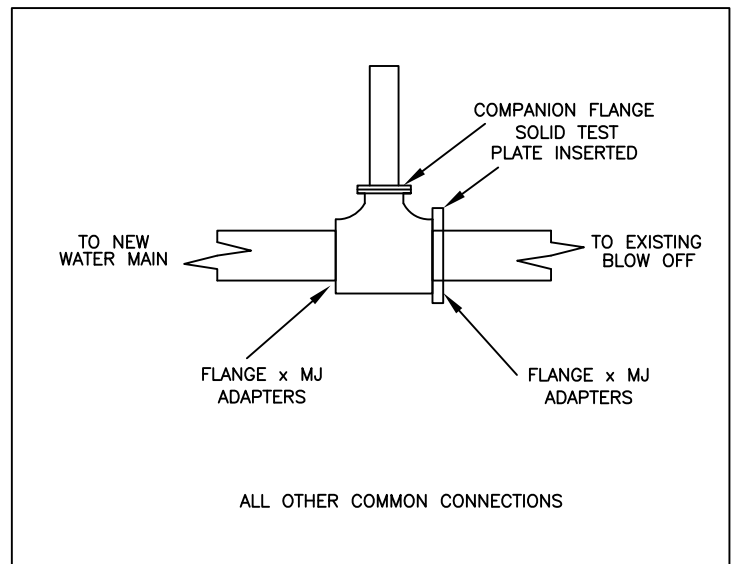

Dublin San Ramon Services District

REVISION DATE  
JAN 2021

CONSTRUCTION JUMPER

REVISED BY  
RM

SIGNED COPY ON FILE AT DISTRICT OFFICE

DRAWING  
W-30