




Dublin San Ramon Services District
Water, wastewater, recycled water

CONSERVATION UPDATE


Irene Suroso
Senior Engineer

February 21, 2023

1

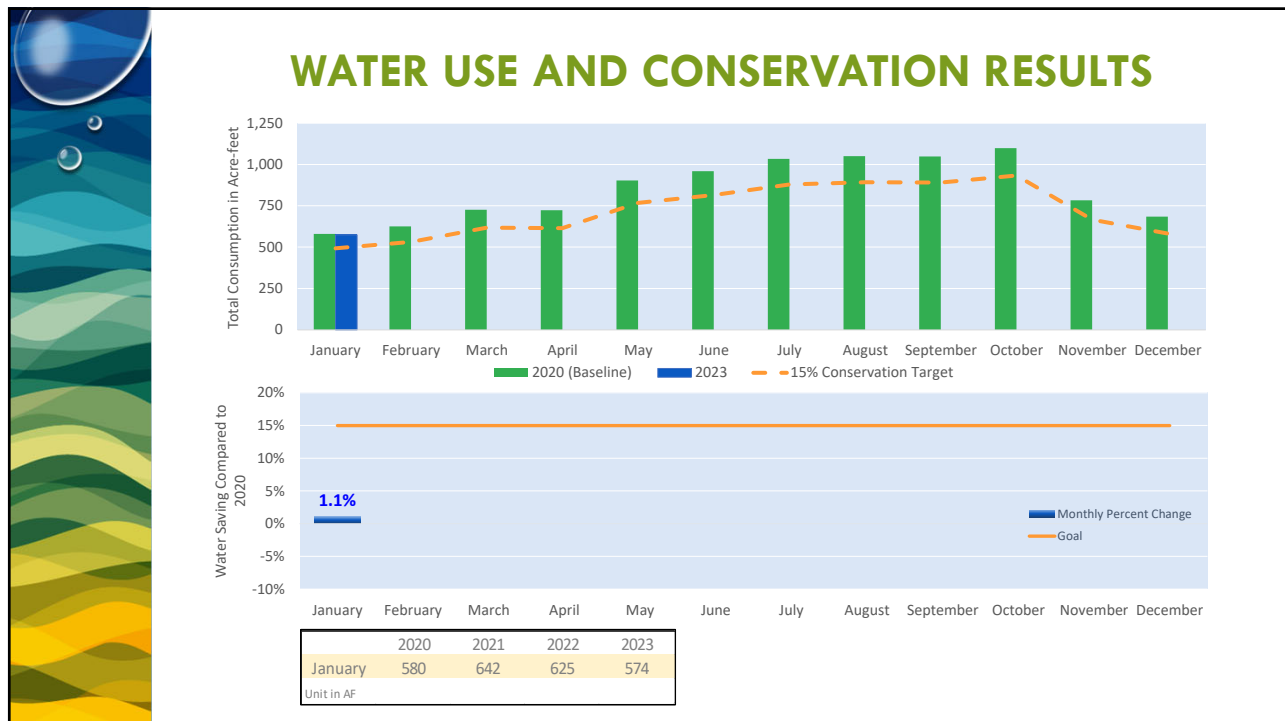

2

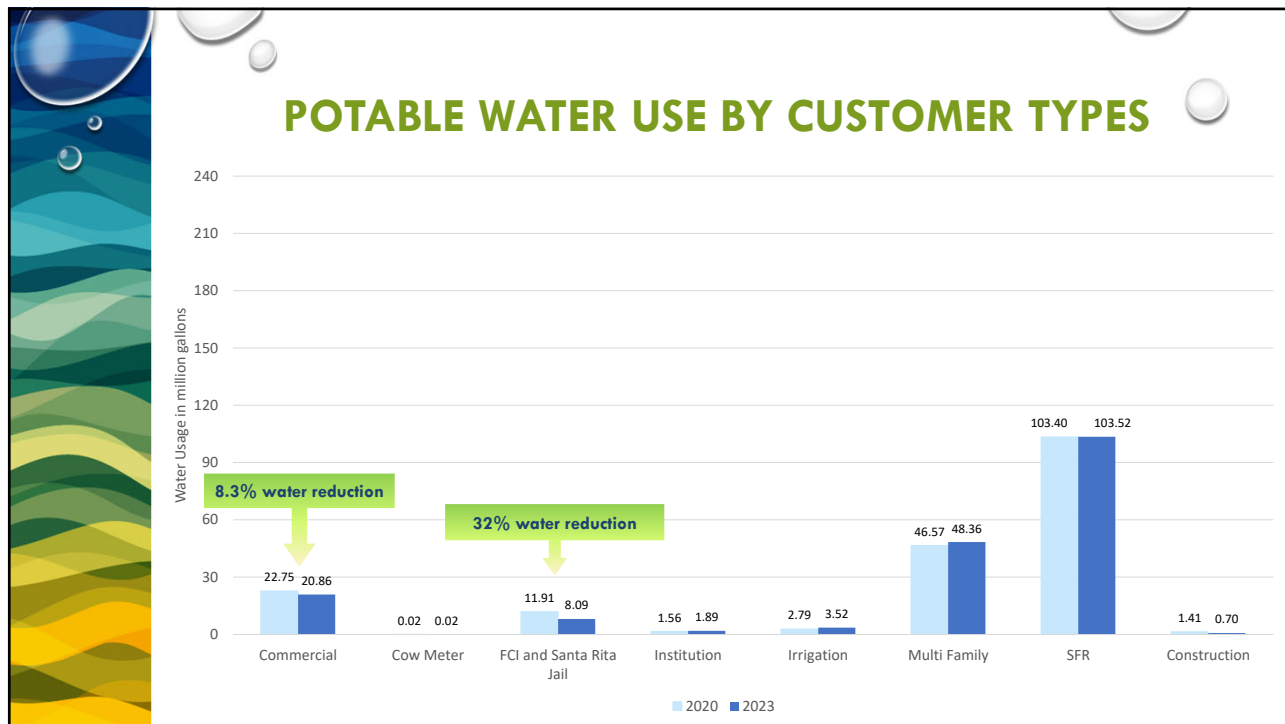

3

PUBLIC OUTREACH

January Pipeline Newsletter

Social Media

- California Native Plant Society webinar
- Zone 7's Qualified Water Efficient Landscaper Training
- Reminder to keep sprinkler off during rain event

District Webpage

4

DROUGHT AND SUPPLY UPDATES




Photo credit: California Department of Water Resources

A drone provides a view of water pumped from the Harvey O. Banks Delta Pumping Plant into the California Aqueduct at 9,790 cubic feet per second after January storms. Photo taken January 20, 2023.

DWR expects to deliver 30% of the requested water supply (State Water Project Allocation)

Zone 7's Operational Plan
10% Conservation
Use of Kern County storage and recovery program
5,000 acre-feet of water transfer

State Emergency Drought remains at Level 2 (in effect until December 2023)

New EO-3-23 (February 13th) directed State to provide recommendations on ongoing emergency drought response action by April 28th

5

QUESTIONS?



6